




SIDE WALL A PLAN
SCALE 1:25

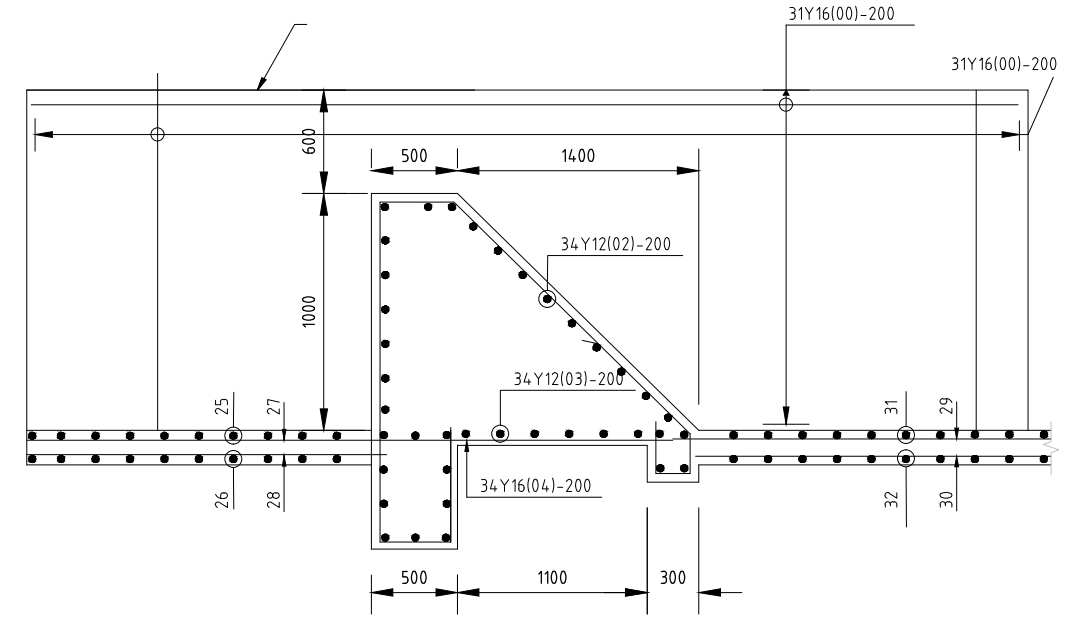


SECTION
SCALE 25

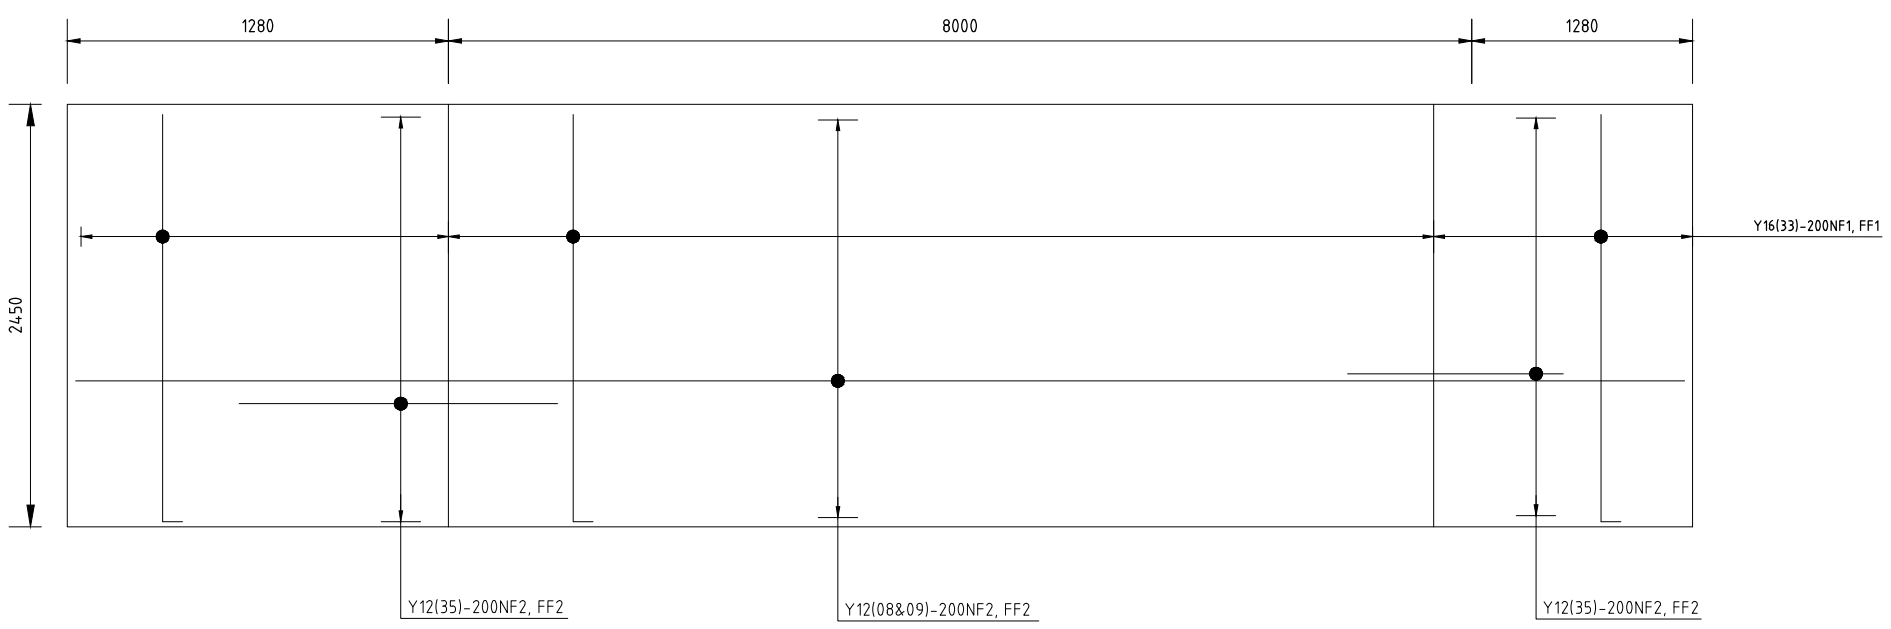


SIDE WALL
SCALE 1:25

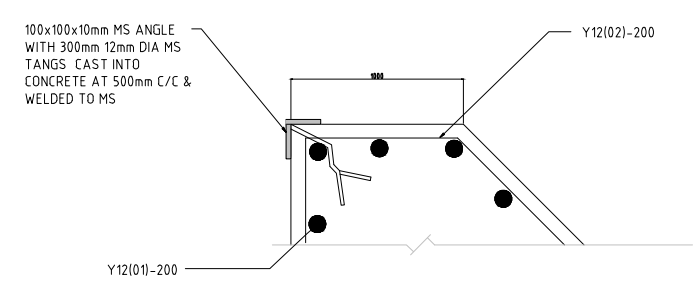

DETAIL
SCALE 1:10

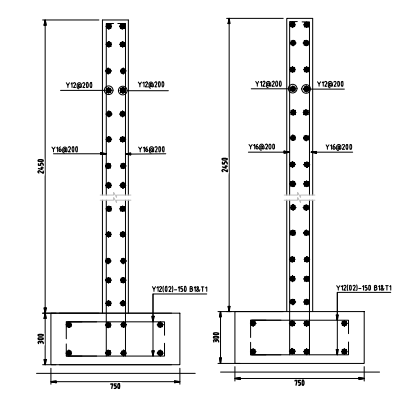

SIDE WALL TYPICAL SECTION FOR WALL (A) AND (E)
SIDE WALL TYPICAL SECTION FOR WALL (B) AND (C)
SECTION SCALE 25

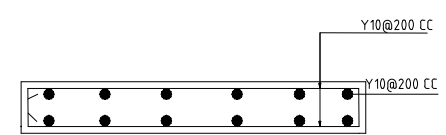

SECTION
SCALE 25

SLAB (F)

NOTES

1. PROGRAMME, METHOD OF CONSTRUCTION AND SETTING OUT OF WORK TO BE APPROVED BY THE ENGINEER BEFORE COMMENCEMENT OF WORK
2. DESIGN CRITERIA
 - (a) DESIGN CODES B.S. 8007 & B.S. 8110
 - (b) UNIFORM NON-COMPRESSIBLE FOUNDATION WITH MINIMUM BEARING CAPACITY 90kN/m²
3. CONCRETE
 - (a) CEMENT TO BE CEM 1 - 42.5 TO KES EAS 18-1 AND KES EAS 18-3
 - (c) WATER IN CONCRETE TO B.S. 3148
 - (d) CONCRETE CLASSES TO BE AS FOLLOWS:-
MASS CONCRETE FILL AND BUNDING MIX, CLASS 15/20.
REINFORCED CONCRETE CLASS 25/20.
 - (e) MINIMUM COVER TO ALL REINFORCEMENT TO BE 40mm UNLESS AS SPECIFIED BELOW
FOR BUILDINGS:-
MEMBERS OF BUILDINGS:-
- SLABS - 20mm
- BEAMS - 25mm
- COLUMNS - 40mm
- FOUNDATIONS AND FOOTINGS - 50mm
IN A FULL HEIGHT POUR AS SOON AS POSSIBLE AFTER THE BASE HAS BEEN CONCRETED (2 TO 3 DAYS)
4. REINFORCEMENT:
 - (a) REINFORCEMENT TO BE HIGH YIELD SQUARE TWISTED BARS TO B.S. 4461
 - (b) BENDING DIMENSIONS TO B.S. 4466
 - (d) EXAMPLE: 16 T12 -07-150 SIGNIFIES 16 No. HIGH AT 150mm CENTRE TO CENTRE SPACING
5. JOINTS
 - (a) THE POSITION AND NUMBER OF INTERMEDIATE AS SHOWN IN THE DRAWINGS
BEFORE PLACING FRESH CONCRETE THE OLD SURFACE SHALL BE ROUGHENED AND ALL LAITANCE AND LOOSE MATERIAL REMOVED
SURFACE DRY CONDITION
HAVE 100mm KICKER UNLESS OTHERWISE SPECIFIED
 - (c) THE UPVC WATER STOP SHALL BE 200mm WIDE UNLESS OTHERWISE SPECIFIED
 - (d) JOINT FILLER TO B.S. 5292 AND TO BE APPROVED BY THE ENGINEER
6. ABBREVIATIONS

T - TOP	B - BOTTOM
N.F. - NEAR FACE	F.F. - FAR FACE
E.F. - EACH FACE	E.W. - EACH WAY

LEGEND

- BF - BLANK FLANGE
- PF - PUDDLE FLANGE
- DN - NOMINAL DIAMETER
- C/C - CENTRE TO CENTRE
- PCC - PRECAST CONCRETE
- RC - REINFORCED CONCRETE
- MS - MILD STEEL
- FC - FLEXIBLE COUPLING
- TWL - TOP WATER LEVEL
- PCC/STEEL - PRE-CAST CONCRETE/STEEL PIPE COUPLING

FOR CONSTRUCTION

REV	REVISIONS	BY	SIGN	DATE	APPROVED
		CHECKED			
		CHECKED			
		CHECKED			
		CHECKED			
		CHECKED			

CLIENT

TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100
NYERI

PROJECT
NGARIAMA NJUKIINI WATER PROJECT

Civil/Structural Engineers

TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100
NYERI

Drawing Title
NGARIAMA NJUKIINI WATER PROJECT
INTAKE
INTAKE SECTIONS (SHEET 2 OF 2)

Designed by DWN	Drawn by EWN
Checked by JMM	Approved by
Scale AS SHOWN (A1)	Date MAY, 2022
Job No. 1	ACAD File: