



200mm THICK WELL DRESSED QUARRY STONES TO BE PLASTERED ON BOTH SIDES TO LINE AND MATCH THE CONCRETE WALLS BELOW

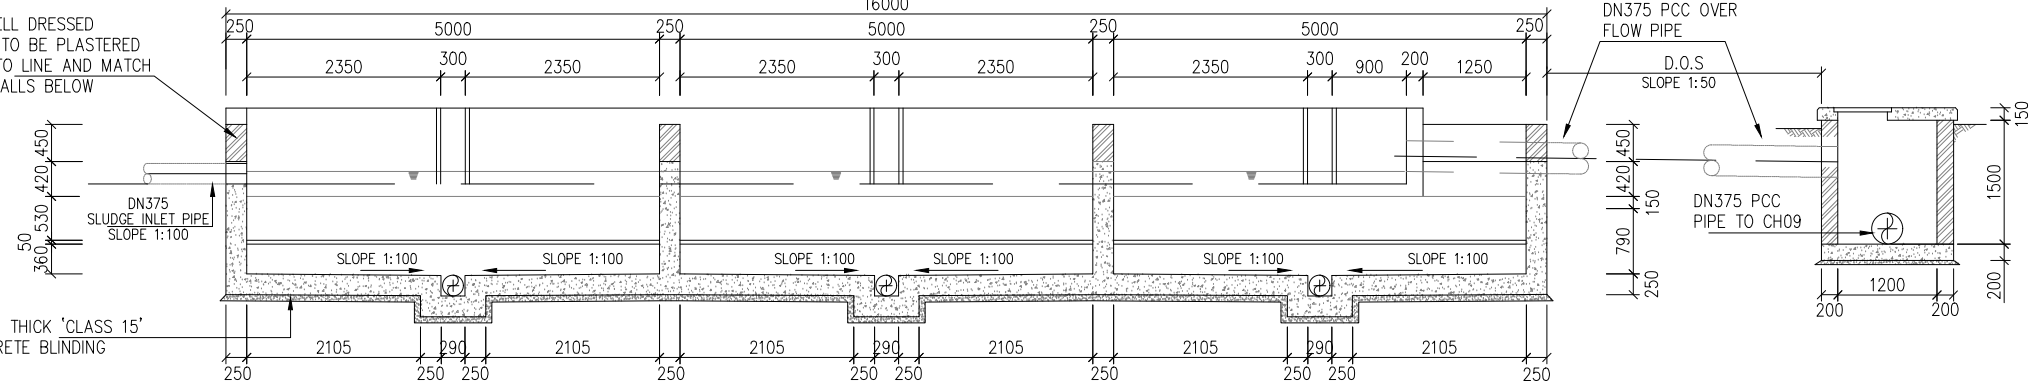


SECTION B-B
SCALE 1:50

200mm THICK WELL DRESSED QUARRY STONES TO BE PLASTERED ON BOTH SIDES TO LINE AND MATCH THE CONCRETE WALLS BELOW

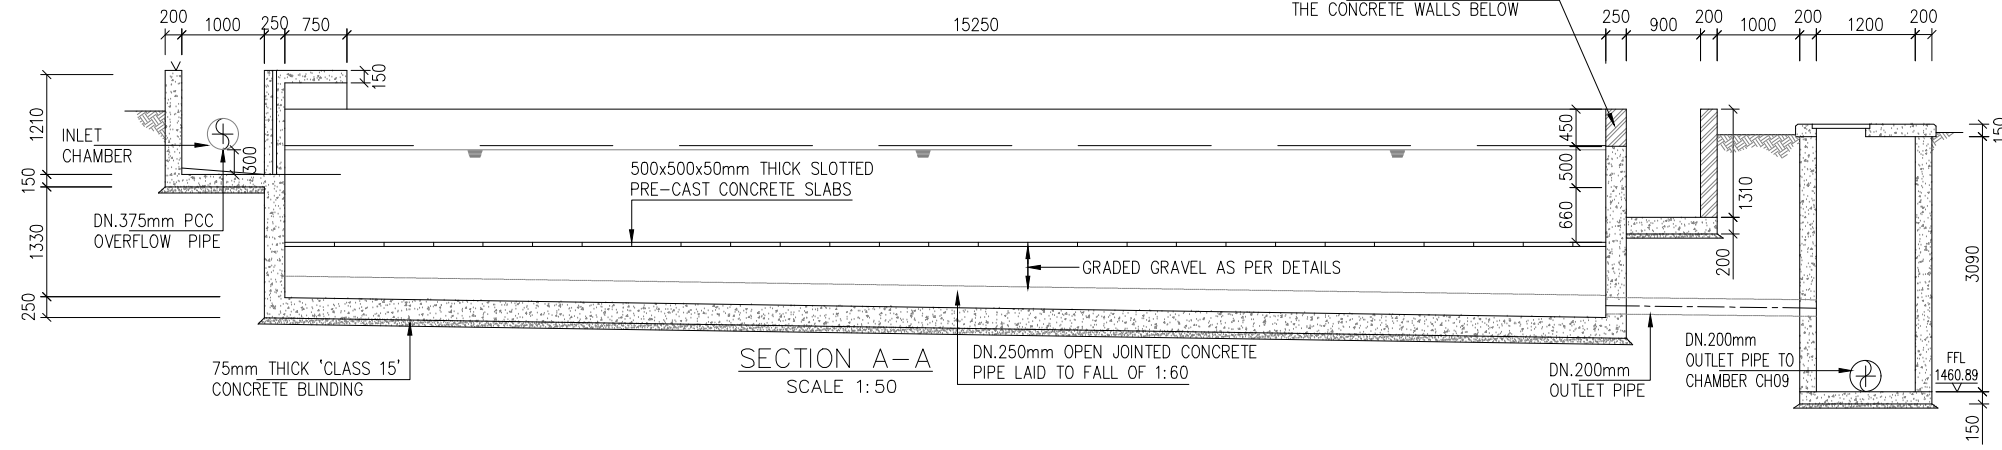


SECTION A-A
SCALE 1:50

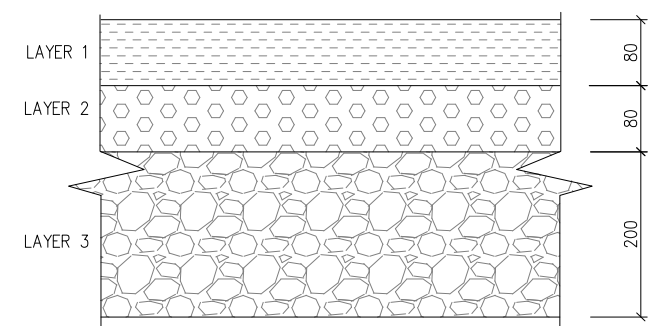

DETAIL OF GRADED GRAVEL UNDERDRAINS
SCALE 1:10

LAYER 1	1/8 INCH SIZED GRAVEL MATERIAL
LAYER 2	1/4 INCH SIZED GRAVEL MATERIAL
LAYER 3	3/4 INCH SIZED GRAVEL MATERIAL

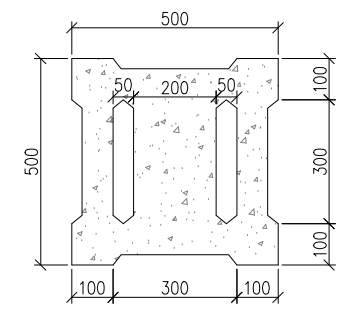

DETAIL OF PCC SLOTTED SLABS
SCALE 1:10

NOTES

- PROGRAMME, METHOD OF CONSTRUCTION AND SETTING OUT OF WORK TO BE APPROVED BY THE ENGINEER BEFORE COMMENCEMENT OF WORK
- DESIGN CRITERIA
 - DESIGN CODES B.S. 8007 & B.S. 8110
 - UNIFORM NON-COMPRESSIBLE FOUNDATION WITH MINIMUM BEARING CAPACITY 90kN/m²
- CONCRETE
 - CEMENT TO BE GEM 1 - 42.5 TO KES EAS 18-1 AND KS EAS 18-3
 - WATER IN CONCRETE TO B.S. 3148
 - CONCRETE CLASSES TO BE AS FOLLOWS:-
MASS CONCRETE FILL AND BLINDING MIX, CLASS 15/20
REINFORCED CONCRETE CLASS 25/20
 - MINIMUM COVER TO ALL REINFORCEMENT TO BE 40mm UNLESS AS SPECIFIED BELOW
FOR BUILDINGS:-
MEMBERS OF BUILDINGS:-
- SLABS - 20mm
- BEAMS - 25mm
- COLUMNS - 40mm
- FOUNDATIONS AND FOOTINGS - 50mm
IN A FULL HEIGHT POUR AS SOON AS POSSIBLE AFTER THE BASE HAS BEEN CONCRETED (2 TO 3 DAYS)
- REINFORCEMENT
 - REINFORCEMENT TO BE HIGH YIELD SQUARE TWISTED BARS TO B.S. 4461
 - BENDING DIMENSIONS TO B.S. 4466
 - EXAMPLE: 16 T12 -07-150 SIGNIFIES 16No. HIGH AT 150mm CENTRE TO CENTRE SPACING
- JOINTS
 - THE POSITION AND NUMBER OF INTERMEDIATE AS SHOWN IN THE DRAWINGS
BEFORE PLACING FRESH CONCRETE THE OLD SURFACE SHALL BE ROUGHENED AND ALL LAITANCE AND LOOSE MATERIAL REMOVED SURFACE DRY CONDITION
HAVE 100mm KICKER UNLESS OTHERWISE SPECIFIED
 - THE uPVC WATER STOP SHALL BE 200mm WIDE UNLESS OTHERWISE SPECIFIED
 - JOINT FILLER TO B.S. 5292AND TO BE APPROVED BY THE ENGINEER
- ABBREVIATIONS

T - TOP	B - BOTTOM
N.F. - NEAR FACE	F.F. - FAR FACE
E.F. - EACH FACE	E.W. - EACH WAY


LEGEND

- BF - BLANK FLANGE
- PF - PUDDLE FLANGE
- DN - NOMINAL DIAMETER
- C/C - CENTRE TO CENTRE
- PCC - PRECAST CONCRETE
- RC - REINFORCED CONCRETE
- MS - MILD STEEL
- FC - FLEXIBLE COUPLING
- TWL - TOP WATER LEVEL
- PCC/STEEL - PRE-CAST CONCRETE/STEEL PIPE COUPLING

FOR CONSTRUCTION

REV	REVISIONS	SIGN	DATE	APPROVED
	BY			
	CHECKED			
	BY			
	CHECKED			
	BY			
	CHECKED			
	BY			
	CHECKED			

CLIENT




TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100
NYERI

PROJECT

NGARIAMA NJUKIINI WATER PROJECT

Civil/Structural Engineers



TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100
NYERI

Drawing Title
NGARIAMA NJUKIINI WATER PROJECT
TREATMENT WORKS SEDIMENTATION TANK
TANK DETAIL (SHEET 2 OF 3)

Designed by DWN	Drawn by EWN
Checked by JMM	Approved by
Scale AS SHOWN (A1)	Date MAY, 2022
Job No. 1	ACAD File:
C STATUS	DRAWING No.TWWDA/NNWP/ST-002
	CO REV