


- NOTES**
1. ALL LEVELS ARE IN METERS ABOVE SEA LEVEL.
 2. COORDINATES ARE BASED ON UTM.
 3. LOCATION OF AIR VALVES, WASHOUTS, BENDS AND OTHER FITTINGS AS SHOWN UNLESS OTHERWISE DIRECTED BY THE ENGINEER ON SITE.
 4. GROUND AND INVERT LEVEL SHOWN ARE AS SHOWN ON DRAWING UNLESS OTHERWISE INDICATED ON SITE BY THE ENGINEER.
 5. PIPES ARE TO BE LAID TO EVEN GRADIENTS WITH A MINIMUM COVER OF 1.0M WHERE COVER IS LESS THAN THIS, PIPE TO BE SURROUNDED WITH CONCRETE.
 6. ALL BENDS ARE HORIZONTAL UNLESS OTHERWISE STATED.
 7. IN WATER LOGGED AREAS, PIPES TO BE BEDDED WITH SINGLE SIZED OR GRADED AGGREGATES AS PER CLAUSE 430.1 AND 216 OF TECHNICAL SPECIFICATIONS AND/OR ANCHOR BLOCKS AS MAY BE DIRECTED ON SITE BY THE ENGINEER.

- LEGEND:**
- — — — — PROPOSED PIPELINE
 - EXISTING GROUND PROFILE
 - PIPE INVERT PROFILE
 - — — — — EXISTING ROAD

- AIR VALVE
- DOUBLE AIR VALVE
- WASHOUT
- WO1 — WASHOUT TYPE 1
- WO2 — WASHOUT TYPE 2
- DN — NOMINAL DIAMETER
- PN — NOMINAL PRESSURE
- VB — VERTICAL BEND
- HB — HORIZONTAL BEND
- EXISTING STRUCTURE
- ER — EARTH ROAD
- GR — GRAVEL ROAD
- CUT

FOR CONSTRUCTION
signed CMTS

REV	REVISIONS	SIGN	DATE	APPROVED
REV-4	BY CHECKED			
REV-3	BY CHECKED			
REV-2	BY CHECKED			
REV-1	ISSUED FOR CONSTRUCTION BY CHECKED			

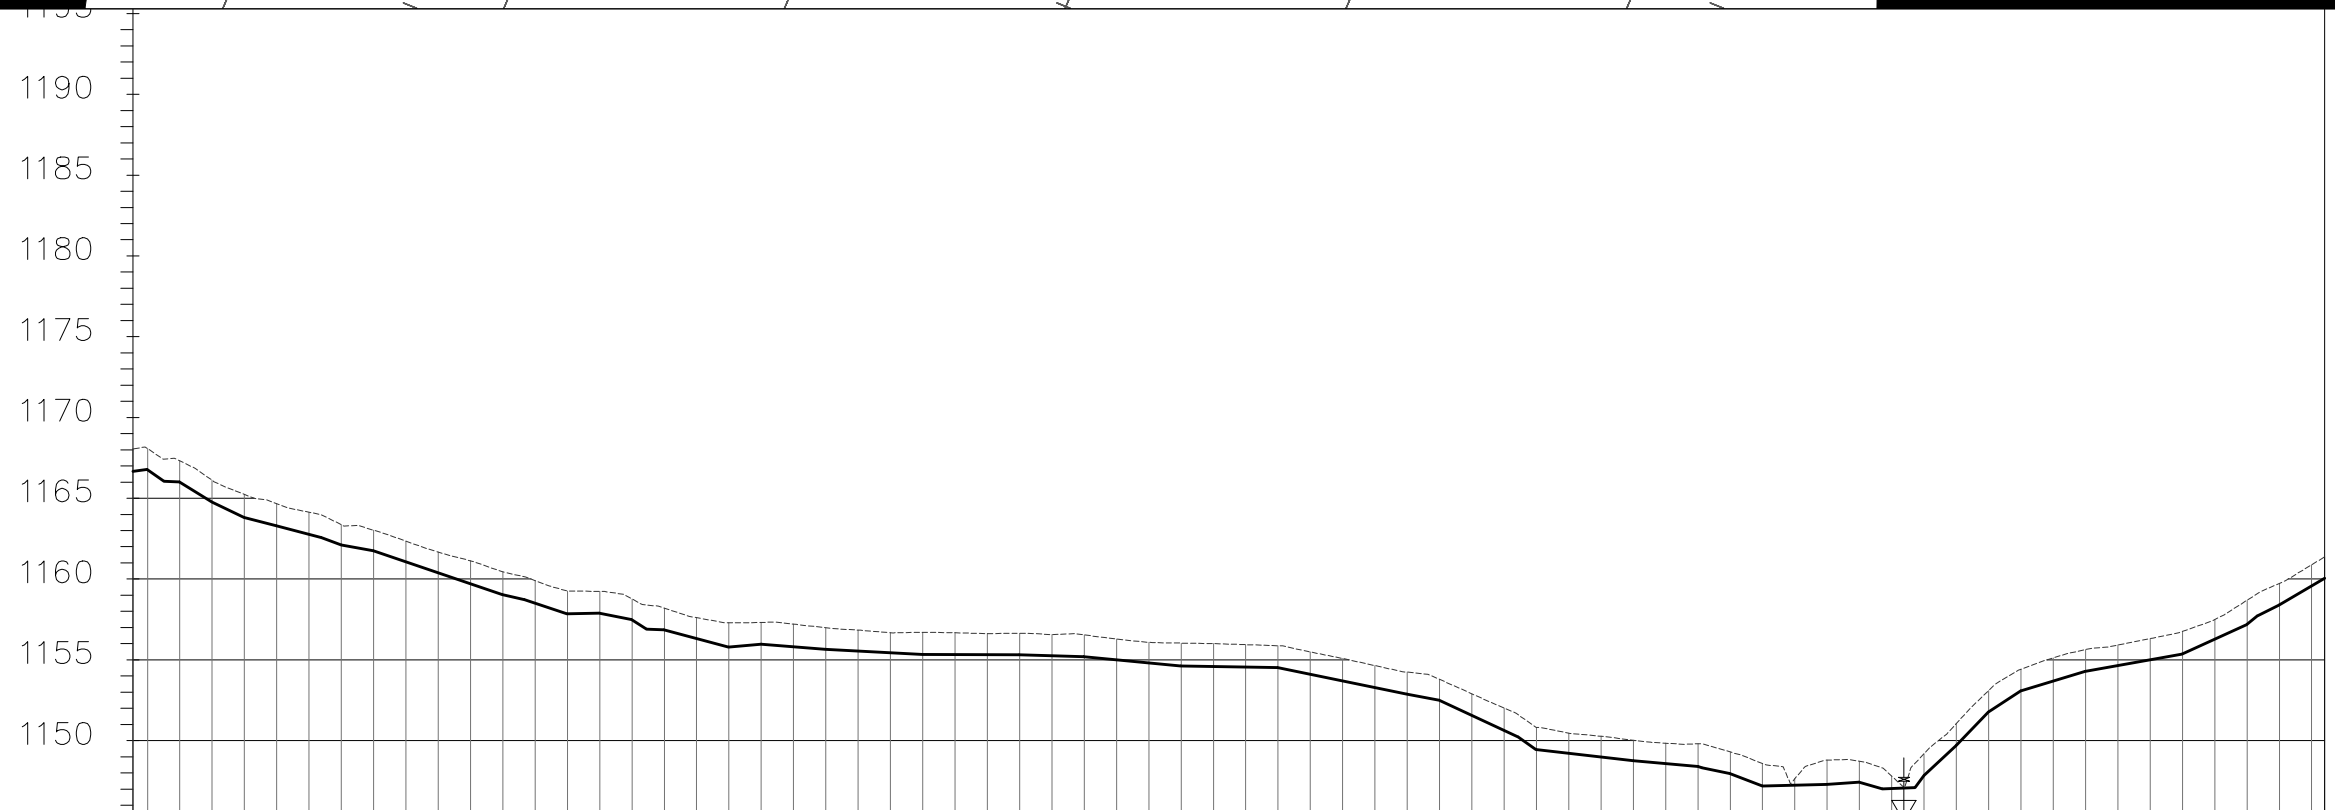

DISTANCE	DATUM (m)	GROUND LEVELS (m)	INVERT LEVELS(m)	DEPTH FROM GROUND LEVEL TO INVERT LEVEL (m)	HGL(m)	FLOW DATA	TYPE OF PIPE AND SIZE
1264.40	1166.67	1168.05	1166.67	1.38	1264.40	0.0116 M3/S	PN12.5 DN 160MM PIPE
1264.36	1166.76	1168.08	1166.76	1.32	1264.36		
1264.28	1165.99	1167.31	1165.99	1.32	1264.28	0.0116 M3/S	PN16 DN 160MM PIPE
1264.21	1164.77	1166.11	1164.77	1.34	1264.21		
1264.13	1163.80	1165.24	1163.80	1.43	1264.13	0.0116 M3/S	PN12.5 DN 160MM PIPE
1264.05	1163.29	1164.67	1163.29	1.38	1264.05		
1263.97	1162.76	1164.14	1162.76	1.38	1263.97	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.89	1162.11	1163.37	1162.11	1.26	1263.89		
1263.81	1161.74	1163.02	1161.74	1.28	1263.81	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.74	1161.06	1162.35	1161.06	1.29	1263.74		
1263.66	1160.38	1161.67	1160.38	1.29	1263.66	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.58	1159.71	1161.13	1159.71	1.43	1263.58		
1263.50	1159.03	1160.44	1159.03	1.41	1263.50	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.42	1158.51	1159.90	1158.51	1.40	1263.42		
1263.34	1157.85	1159.26	1157.85	1.41	1263.34	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.27	1157.88	1159.23	1157.88	1.35	1263.27		
1263.19	1157.48	1158.76	1157.48	1.28	1263.19	0.0116 M3/S	PN12.5 DN 160MM PIPE
1263.11	1156.86	1158.21	1156.86	1.35	1263.11		
1263.03	1156.32	1157.61	1156.32	1.29	1263.03	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.95	1155.79	1157.29	1155.79	1.50	1262.95		
1262.87	1155.96	1157.31	1155.96	1.35	1262.87	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.80	1155.81	1157.21	1155.81	1.41	1262.80		
1262.72	1155.65	1156.98	1155.65	1.33	1262.72	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.64	1155.55	1156.84	1155.55	1.29	1262.64		
1262.56	1155.44	1156.68	1155.44	1.24	1262.56	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.48	1155.34	1156.70	1155.34	1.36	1262.48		
1262.40	1155.33	1156.68	1155.33	1.35	1262.40	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.33	1155.32	1156.63	1155.32	1.30	1262.33		
1262.25	1155.31	1156.64	1155.31	1.33	1262.25	0.0116 M3/S	PN12.5 DN 160MM PIPE
1262.17	1155.26	1156.57	1155.26	1.31	1262.17		
1262.08	1155.20	1156.54	1155.20	1.34	1262.08	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.98	1155.01	1156.28	1155.01	1.28	1261.98		
1261.89	1154.81	1156.09	1154.81	1.27	1261.89	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.80	1154.62	1156.04	1154.62	1.41	1261.80		
1261.71	1154.59	1156.00	1154.59	1.41	1261.71	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.61	1154.55	1155.94	1154.55	1.39	1261.61		
1261.52	1154.51	1155.87	1154.51	1.36	1261.52	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.43	1154.10	1155.49	1154.10	1.38	1261.43		
1261.33	1153.69	1155.08	1153.69	1.39	1261.33	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.24	1153.28	1154.64	1153.28	1.37	1261.24		
1261.15	1152.87	1154.24	1152.87	1.37	1261.15	0.0116 M3/S	PN12.5 DN 160MM PIPE
1261.06	1152.49	1153.79	1152.49	1.30	1261.06		
1260.96	1151.56	1152.90	1151.56	1.34	1260.96	0.0116 M3/S	PN12.5 DN 160MM PIPE
1260.87	1150.62	1152.01	1150.62	1.39	1260.87		
1260.78	1149.45	1150.82	1149.45	1.37	1260.78	0.0116 M3/S	PN12.5 DN 160MM PIPE
1260.68	1149.21	1150.47	1149.21	1.25	1260.68		
1260.59	1148.98	1150.27	1148.98	1.29	1260.59	0.0116 M3/S	PN12.5 DN 160MM PIPE
1260.50	1148.75	1150.02	1148.75	1.27	1260.50		
1260.41	1148.57	1149.84	1148.57	1.27	1260.41	0.0116 M3/S	PN12.5 DN 160MM PIPE
1260.31	1148.39	1149.80	1148.39	1.41	1260.31		
1260.22	1147.95	1149.30	1147.95	1.35	1260.22	0.0116 M3/S	PN12.5 DN 160MM PIPE
1260.13	1147.19	1148.58	1147.19	1.40	1260.13		
1260.04	1147.24	1147.64	1147.24	0.40	1260.04	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.94	1147.30	1148.80	1147.30	1.50	1259.94		
1259.85	1147.42	1148.72	1147.42	1.30	1259.85	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.76	1147.04	1147.80	1147.04	0.76	1259.76		
1259.66	1147.84	1149.19	1147.84	1.36	1259.66	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.57	1149.72	1151.06	1149.72	1.34	1259.57		
1259.48	1151.79	1153.10	1151.79	1.31	1259.48	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.39	1153.08	1154.42	1153.08	1.33	1259.39		
1259.29	1153.69	1155.12	1153.69	1.43	1259.29	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.20	1154.30	1155.63	1154.30	1.34	1259.20		
1259.11	1154.65	1155.92	1154.65	1.27	1259.11	0.0116 M3/S	PN12.5 DN 160MM PIPE
1259.01	1155.01	1156.31	1155.01	1.31	1259.01		
1258.92	1155.37	1156.75	1155.37	1.38	1258.92	0.0116 M3/S	PN12.5 DN 160MM PIPE
1258.83	1156.28	1157.50	1156.28	1.22	1258.83		
1258.75	1157.19	1158.69	1157.19	1.49	1258.75	0.0116 M3/S	PN12.5 DN 160MM PIPE
1258.67	1158.40	1159.73	1158.40	1.33	1258.67		
1258.58	1160.39	1161.37	1158.58	1.30	1258.58	0.0116 M3/S	PN12.5 DN 160MM PIPE
1258.50	1161.37	1162.35	1160.39	1.31	1258.50		

RIANDUSIAKAGO ALIGN
SCALE: HOR 1:2000 VERT 1:1000

CLIENT
 TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100 NYERI

PROJECT
DESIGN FOR REHABILITATION OF ENA SIAKAGO WATER PROJECT

Civil/Structural Engineers
 TANA WATER WORKS DEVELOPMENT AGENCY
P. O. BOX 1292-10100 NYERI

Drawing Title
RIANDU_SIAKAGO_TWM
PLAN_AND_PROFILE_DRAWINGS

Designed by DWN	Drawn by MMN
Checked by JMM	Approved by
Scale 1:1750	Date SEP2022
Job No. 1.0	ACAD File: ACADFILENAME
PD STATUS	DRAWING No. 1-RS\PD\04
REV	