


SECTION D-D

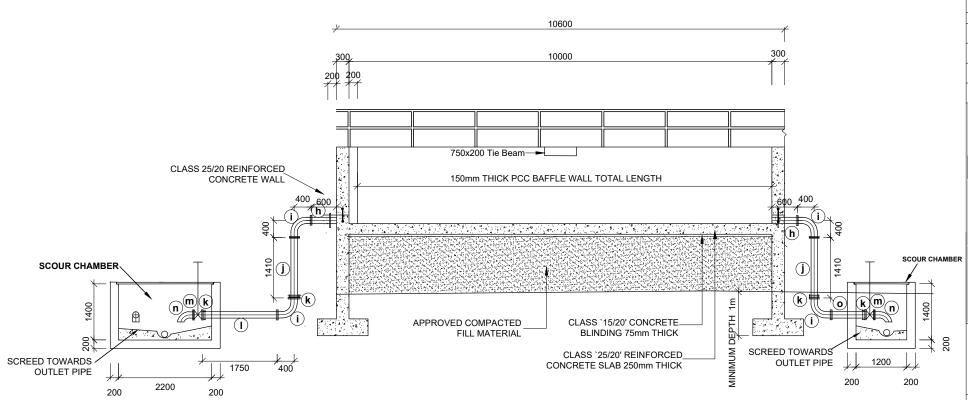

SECTION E-E

NOTES

- ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE STATED
- 2. ALL LEVELS ARE IN METRES UNLESS OTHERWISE STATED
- ALL EXPOSED CONCRETE EDGES SHALL HAVE A 20x20mm CHAMFER
- SLOT WIDTH TO BE 0.2m FOR THE FIRST $\%_3$ LENGTH OF THE BASIN AND 0.3m FOR THE LAST 1/3 LENGTH OF THE BASIN

LEGEND

DN - NOMINAL DIAMETER

PCC - PRECAST CONCRETE

RC - REINFORCED CONCRETE

GMS - GALVANISED MILD STEEL

EGL - EXISTING GROUND LEVEL

FGL - FINISHED GROUND LEVEL

FL - FINISHED LEVEL

FOR CONSTRUCTION

REV	REVISIONS		SIGN	DATE	APPROVED
		BY			
		CHECKED			
		BY			
		CHECKED			
		BY			
		CHECKED			
СО	ISSUED FOR CONSTRUCTION	BY			
		CHECKED			1

CLIENT



TANA WATER WORKS DEVELOPMENT AGENCY P. O. BOX 1292-10100 NYERI

DESIGN FOR KAHARO WATER TREATMENT WORKS — OTHAYA

Civil/Structural Engineers



TANA WATER WORKS DEVELOPMENT AGENCY P. O. BOX 1292-10100 NYERI

Drawing Title
KAHARO WATER TREATMENT WORKS STILLING WELL , CHEMICAL DOSING AND FLOCCULATION BASIN PLAN

Desig	nec	d by DWN	Drawn by EWN			
Checl	ked	by JMM	Approved by			
Scale AS SHOWN (A1)			Date SEP 2022			
Job No. 1		1	ACAD File:			
PD STATUS DRAWING No. TWWDA/KTW/FB-03 RE						