


NOTES:

1. DIMENSIONS IN mm UNLESS OTHERWISE SPECIFIED
2. ALL EXPOSED CONCRETE EDGES TO HAVE A 25mm x 25mm CHAMFER
3. ALL INTERNAL SURFACES OF MIXING TANKS TO BE LINED WITH 3 COATS OF APPROVED EPOXY LINING
4. CONCRETE WORKS: ALL REINFORCED CONCRETE TO BE CLASS 25/20 EXCEPT WHERE OTHERWISE SPECIFIED
5. ABBREVIATIONS
 R.C - REINFORCED CONCRETE
 D.P.C - DAMP PROOF COURSE
 E.G.L - EXISTING GROUND LEVEL
 F.G.L - FINISHED GROUND LEVEL
 F.F.L - FINISHED FLOOR LEVEL
 P.C.C - PRECAST CONCRETE
 G.C.I - GALVANIZED CORRUGATED IRON
6. EDGES OF TREADS AND RISERS IN CONCRETE STAIRCASE TO BE PROTECTED WITH 40 x 40 x 3mm M.S. ANGLE FIXED WITH FISH TAIL LUGS EMBEDDED IN CONCRETE



**CHEMICAL STORAGE AND MIXING BUILDING
FIRST FLOOR & MIXING PLATFORM PLAN**

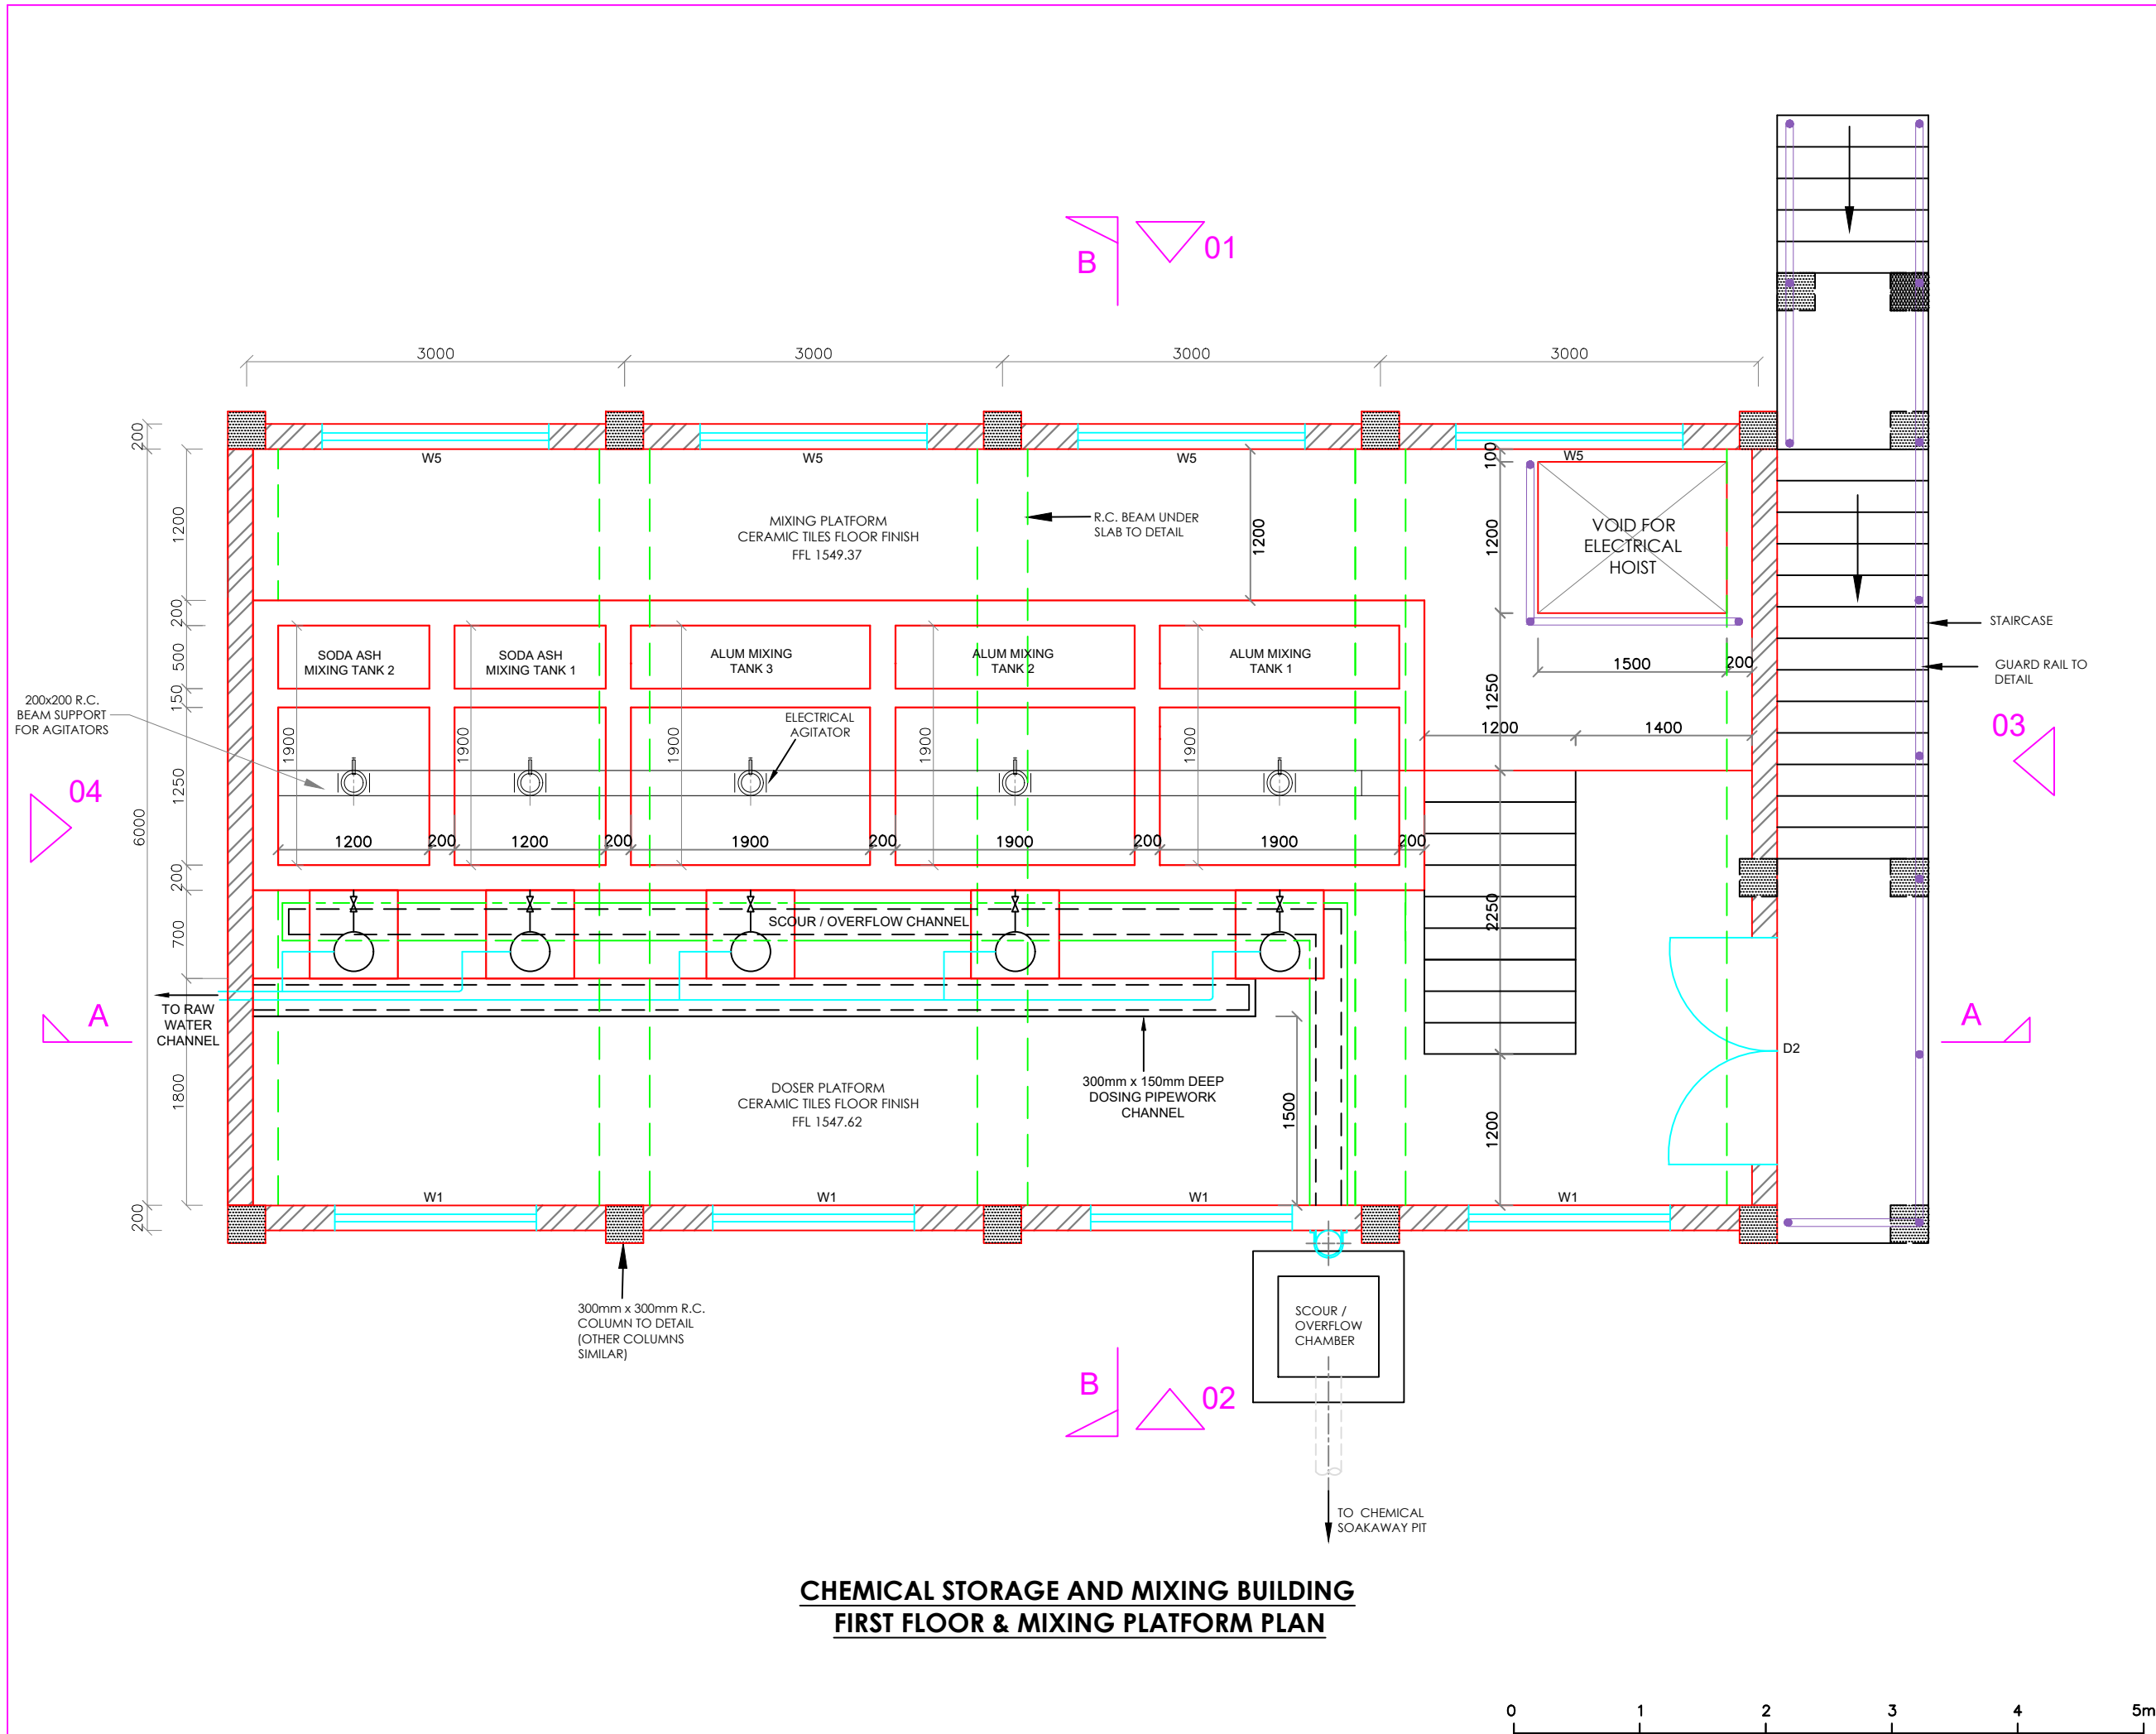

CLIENT: **THE CHIEF EXECUTIVE OFFICER
TANA WATER WORKS
DEVELOPMENT AGENCY**
P.O BOX 1292 - 10100,
NYERI, KENYA

ENGINEER: **CHIEF MANAGER TECHNICAL
SERVICES
TANA WATER WORKS
DEVELOPMENT AGENCY**
P.O BOX 1292 - 10100,
NYERI, KENYA

PROJECT TITLE:
**TETU AGUTHI WATER
SUPPLY PROJECT**

DRAWING TITLE:
**TETU AGUTHI WATER TREATMENT
WORKS**

**CHEMICAL STORAGE AND MIXING
BUILDING
FIRST FLOOR AND MIXING PLATFORM**

Designed by: R.M.N.	Drawn by: R.M.N.
Checked by: J.M.M	Approved by: D.N.M
Scale: 1:50	Date: JAN 2024

DRG No. **TAWP/CMB/02**