


**NOTES:**


1. DIMENSIONS IN mm UNLESS OTHERWISE SPECIFIED
2. ALL EXPOSED CONCRETE EDGES TO HAVE A 25mm x 25mm CHAMFER
3. ALL JOINTS BETWEEN WALLS AND FLOOR TO HAVE A BENCHING NOT EXCEEDING 200mm THICK TO SMOOTHEN SHARP CORNERS
4. CONCRETE WORKS: ALL REINFORCED CONCRETE TO BE CLASS 25/20 EXCEPT WHERE OTHERWISE SPECIFIED

5. ABBREVIATIONS

- C/C - CENTRE TO CENTRE
- R.C - REINFORCED CONCRETE
- E.G.L - EXISTING GROUND LEVEL
- F.G.L - FINISHED GROUND LEVEL
- F.F.L - FINISHED FLOOR LEVEL
- P.C.C - PRECAST CONCRETE
- G.M.S - GALVANIZED MILD STEEL
- C.I - CAST IRON

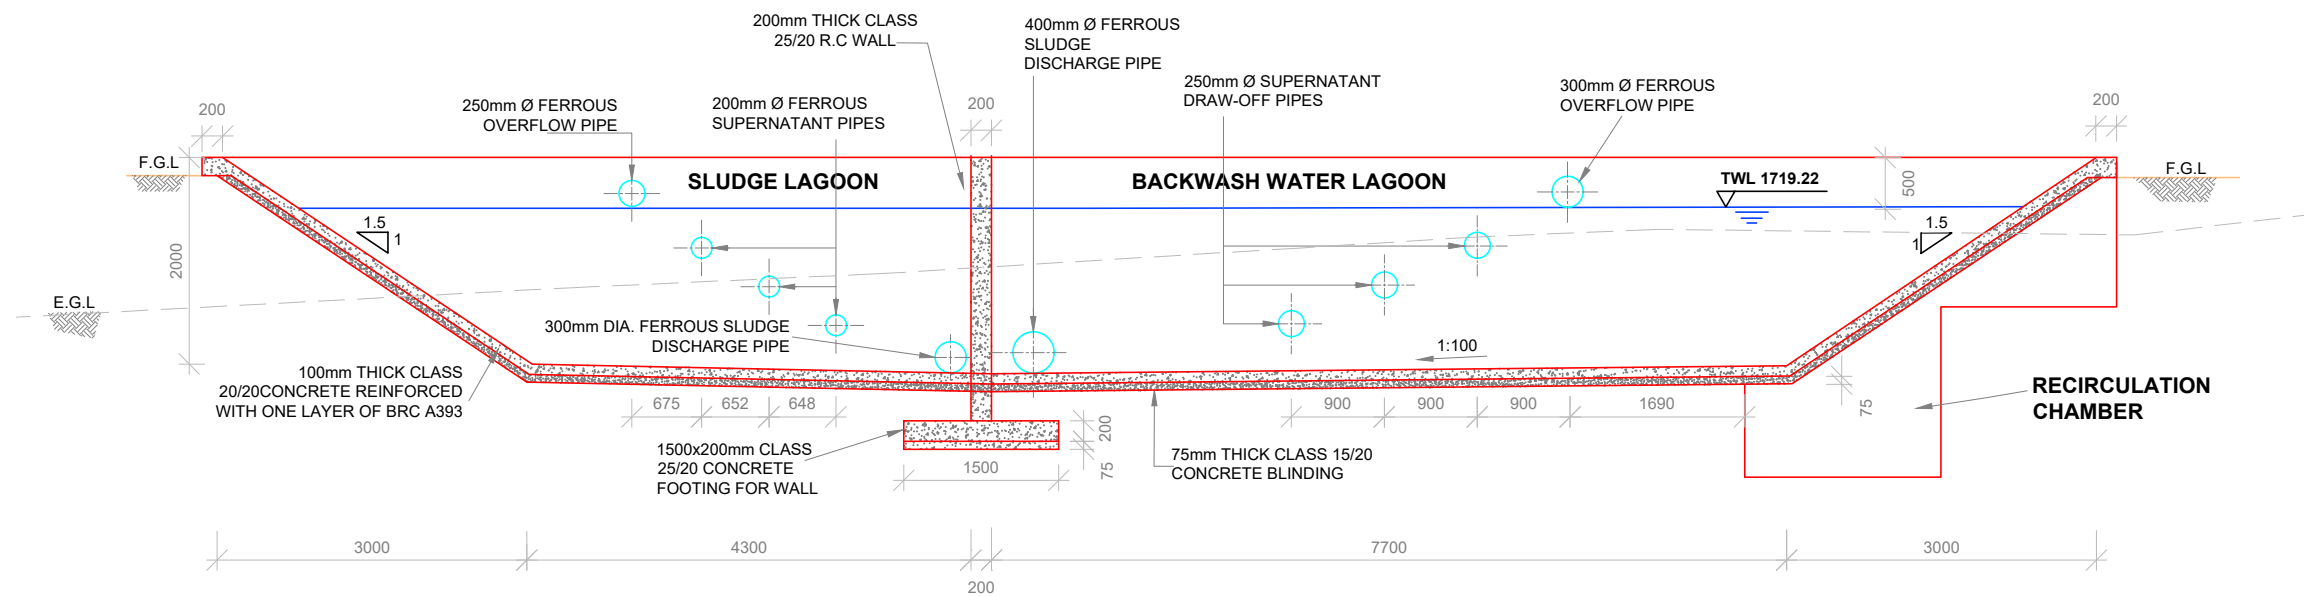

**SECTION A-A**

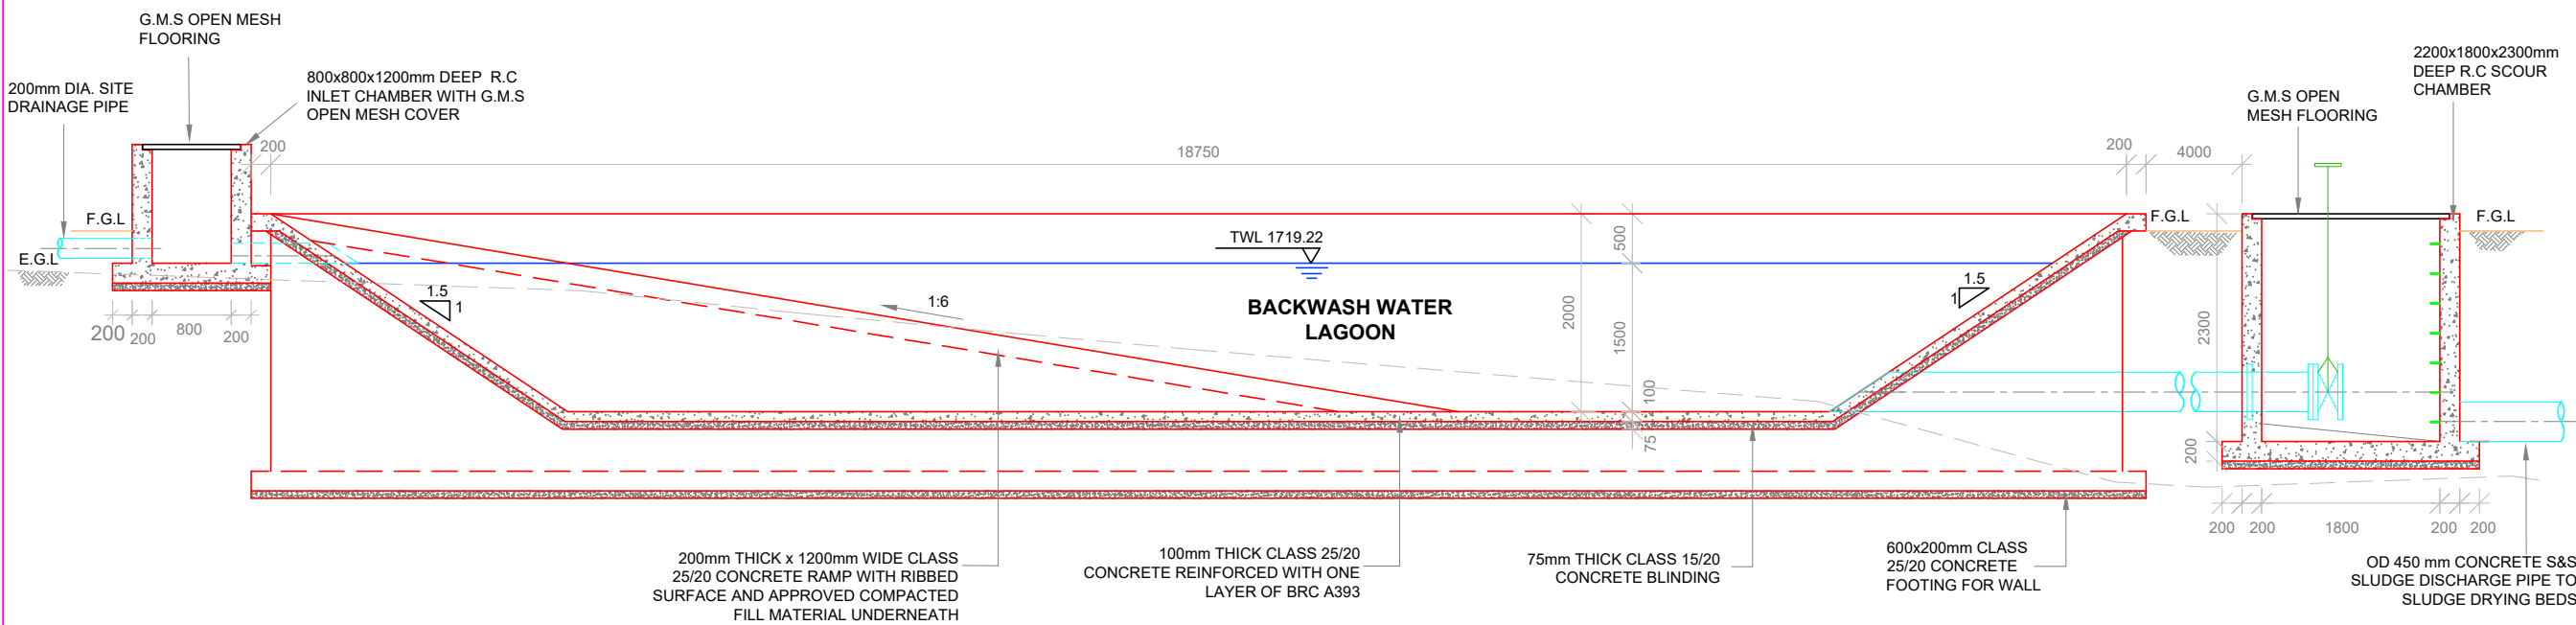

**SECTION B - B**

CLIENT: **THE CHIEF EXECUTIVE OFFICER  
TANA WATER WORKS  
DEVELOPMENT AGENCY**  
P.O BOX 1292 - 10100,  
NYERI, KENYA

ENGINEERS: **THE CHIEF MANAGER TECHNICAL  
SERVICES  
TANA WATER WORKS  
DEVELOPMENT AGENCY**  
P.O BOX 1292 - 10100,  
NYERI, KENYA

PROJECT TITLE:  
**TETU- AGUTHI WATER SUPPLY**

DRAWING TITLE:  
**TETU WATER TREATMENT WORKS**

**BACKWASH WATER LAGOON SLUDGE  
LAGOON, AND RECIRCULATION PUMP  
CHAMBER SECTIONS**

Designed by: R.M.N.	Drawn by: R.M.N.
Checked by: J.M.M	Approved by: D.N.M
Scale: 1:120	Date: JAN 2024

DRG No. **TAWP/BWSL/02**