
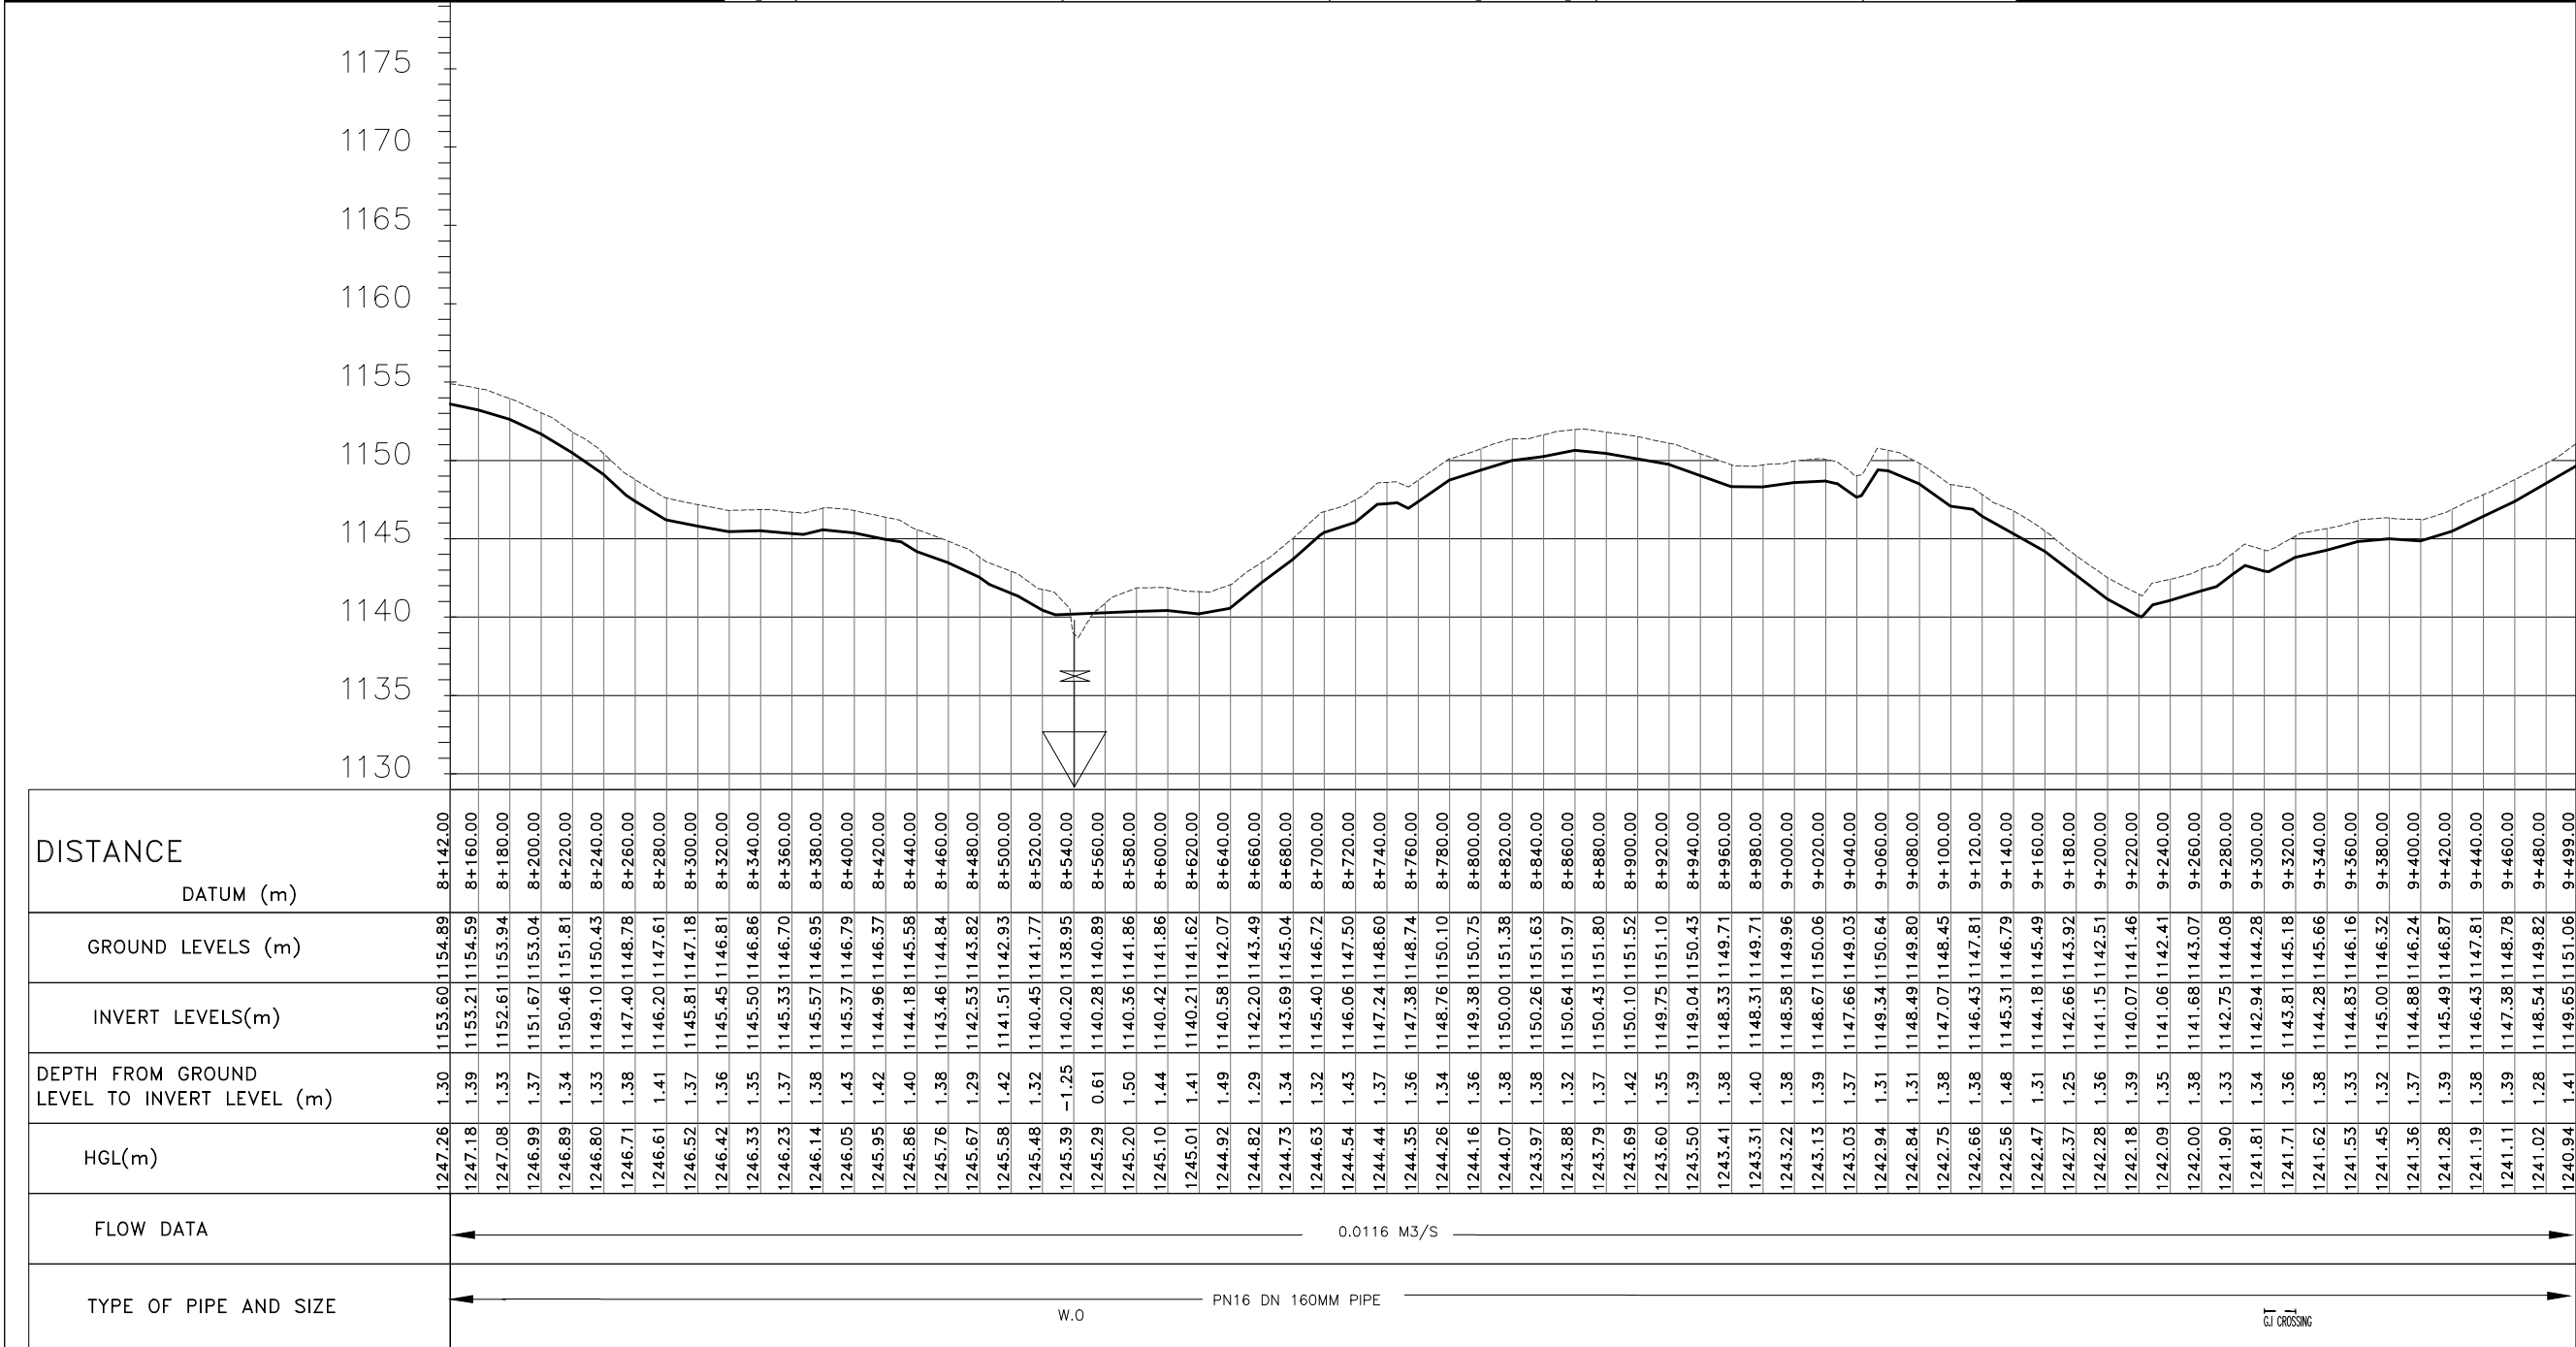


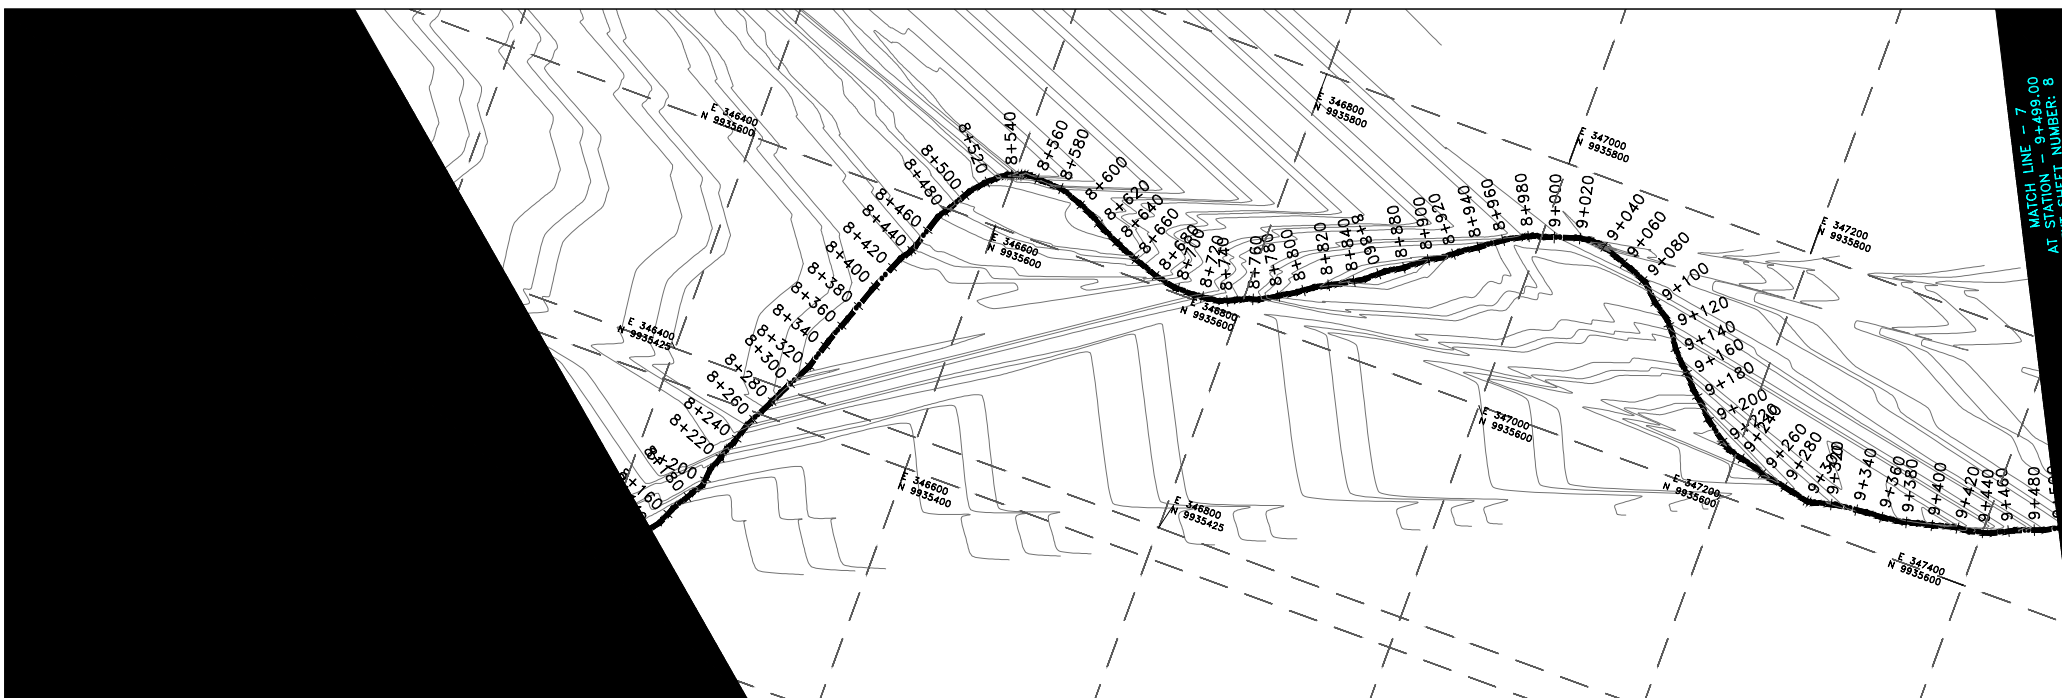

RIANDUSIAKAGO ALIGN
SCALE: HOR 1:2000 VERT 1:1000

- # NOTES
1. ALL LEVELS ARE IN METERS ABOVE SEA LEVEL.
 2. COORDINATES ARE BASED ON UTM.
 3. LOCATION OF AIR VALVES, WASHOUTS, BENDS AND OTHER FITTINGS AS SHOWN UNLESS OTHERWISE DIRECTED BY THE ENGINEER ON SITE.
 4. GROUND AND INVERT LEVEL SHOWN ARE AS SHOWN ON DRAWING UNLESS OTHERWISE INDICATED ON SITE BY THE ENGINEER.
 5. PIPES ARE TO BE LAID TO EVEN GRADIENTS WITH A MINIMUM COVER OF 1.0M. WHERE COVER IS LESS THAN THIS, PIPE TO BE SURROUNDED WITH CONCRETE.
 6. ALL BENDS ARE HORIZONTAL UNLESS OTHERWISE STATED.
 7. IN WATER LOGGED AREAS, PIPES TO BE BEDDED WITH SINGLE SIZED OR GRADED AGGREGATES AS PER CLAUSE 430.1 AND 216 OF TECHNICAL SPECIFICATIONS AND/OR ANCHOR BLOCKS AS MAY BE DIRECTED ON SITE BY THE ENGINEER.

LEGEND:

- | | |
|---|---------------------------|
|  | – PROPOSED PIPELINE |
|  | – EXISTING GROUND PROFILE |
|  | – PIPE INVERT PROFILE |
|  | – EXISTING ROAD |
|  | – AIR VALVE |
| DAV | – DOUBLE AIR VALVE |
|  | – WASHOUT |
| WO1 | – WASHOUT TYPE 1 |
| WO2 | – WASHOUT TYPE 2 |
| DN | – NOMINAL DIAMETER |
| PN | – NOMINAL PRESSURE |
| VB | – VERTICAL BEND |
| HB | – HORIZONTAL BEND |
|  | – EXISTING STRUCTURE |
| ER | – EARTH ROAD |
| GR | – GRAVEL ROAD |
|  | – CUT |

FOR CONSTRUCTION

signed CMTS

REV	REVISIONS	SIGN	DATE	APPROVED
REV-4	BY			
	CHECKED			
REV-3	BY			
	CHECKED			
REV-2	BY			
	CHECKED			
REV-1	ISSUED FOR CONSTRUCTION	BY		
	CHECKED			

CLIENT



PROJECT

DESIGN FOR REHABILITATION OF
ENA SIAKAGO WATER PROJECT

Civil/Structural Engineers



Drawing Title
RIANDU_SIAKAGO_TWM

PLAN_AND_PROFILE_DRAWINGS

Designed by DWN		Drawn by MMN	
Checked by JMM		Approved by	
Scale 1:1750		Date SEP2022	
Job No.	1.0	ACAD File: ACADFILENAME	
PD STATUS	DRAWING No.	1-RS\PD\07	REV